

Technical Support

 1.800.672.7298



supportUS@paxton-access.com

Technical help is available: Monday - Friday from 02:00 AM - 8:00 PM (EST)


Documentation on all Paxton products can be found on our web site - <http://www.paxton-access.com/>

For instructions in alternative languages - <http://paxton.info/1000>

Mounting

Ensure that the backbox is mounted vertically and is square with the wall surface.


Care must be taken when doing this, as no further 'twist' adjustment is possible within the reader mountings.

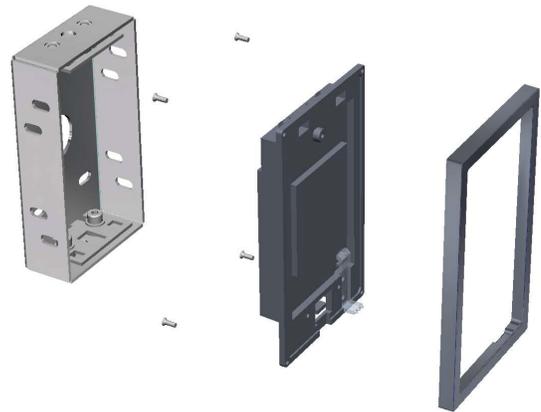

Reader insert (Sold separately)

The reader insert is held against the backplate by an outer decorative bezel secured with 4 small screws. Remove these screws to release the bezel and refit after adding the insert.

If you have made an insert of less than 3/16 inch thick, this can still be fitted by using the 3 nylon screws supplied in the fitting kit to hold the insert against the bezel. (see diagram)

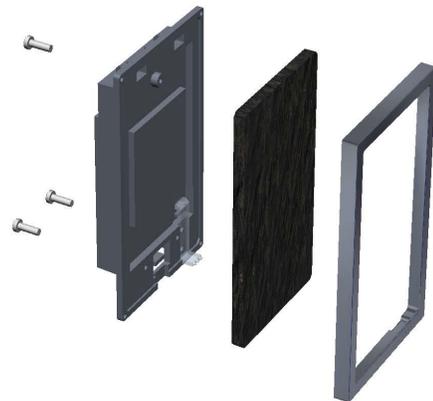

Mounting the reader

Line up the two locating pins on the top of the reader with the top plate inside the backbox. Once located, the reader can be clipped into the box at the bottom using the clip feature.


Check that the reader is located against the surface of the wall. If there is a gap between the reader and the wall, or if the reader will not successfully clip into the box, remove the reader and adjust the mounting plates inside the backbox using a 3 mm Allen key.

Removing the reader

To remove the reader, insert the tool provided into the cut out on the underside of the reader. Push up the clip and pull the reader from the backbox.



Wiring

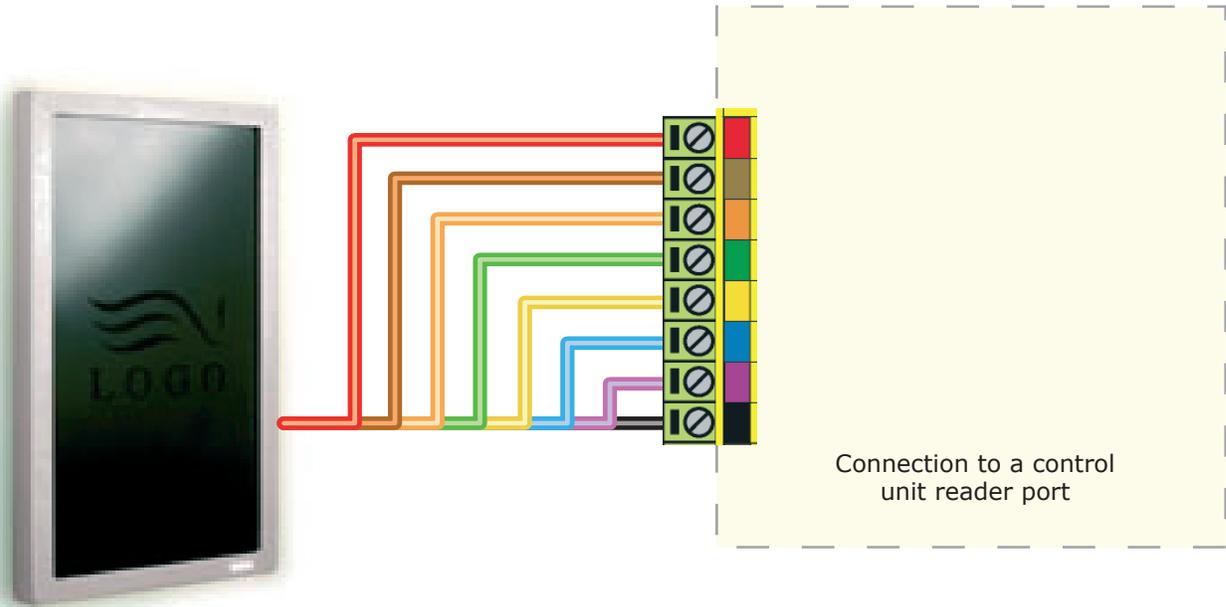

IMPORTANT: This reader cannot be connected in parallel with other readers and keypads.

Connection modules

Reader junction box (325-020-US)

This module can be used to provide a connection point for the reader RJ45 plug. The terminals on the module are then wired color for color to the controller.


Alternatively, the reader can be wired directly into the screw terminals of the control unit by first cutting off the RJ45 plug and stripping back the wires in the cable.



Reader Port Module (325-030-US)

This module may be purchased separately to speed up the installing and replacement of readers.

The reader port module is designed to convert the standard reader ports on Switch2 and Net2 controllers to accept one or two RJ45 connections. Pull off the screw terminal block from the reader port and simply replace it with this module.



Cable extensions

Readers can be extended using the guidelines below:

- Belden 9538/ Belden 5506FE (USA) ≤ 25m/82ft
- Belden 9540/ Belden 5306FE (USA) ≤ 100m/328ft

Technical Help

Here is the list of topics about this product that receive the most technical support inquiries. We list them here to help you speed up the installation and trouble shooting process.

1 - Readers/Keypads not working.

- Software settings - Confirm that the settings of the reader or keypad are correct.
- Connections - Check the wiring and integrity of the connectors. If possible, test this reader on the other port.
- Cable - To confirm that an extended reader cable is not at fault, wire the reader directly to the port.
- Supply voltage - Confirm that the voltage is within specification. (see table)
- User token - Confirm that the user token used for testing is OK by presenting it to a known working reader.
- Interference - Confirm whether the reader works when tested 'in hand' and not mounted on the wall.
Ensure PROXIMITY readers are not mounted back to back or that there is no interference from other RF devices.

2 - Net2. What to do if a user has no access - Check the reader LEDs when a card is shown.

- No LEDs - the reader has no power.
- No change in display - try the card on a known working reader. If there is still no response, replace the card.
- Green LED flashing when a card is presented; check relay 1 LED to check for activity and also the lock wiring.
- Red LED is flashing when a card is presented; check the validity of the user at the PC.
Check user's access level and ensure they should have access by clicking on Current Validity.
Check the 'Valid Until' date and confirm this has not expired.
- Reinstate the ACU from the doors screen. Select the ACU's you wish to reinstate and then click OK.

3 - Switch2 - Adding an additional card pack.

You need to be in possession of the original enrolment card. Present the original enrolment card to the reader and the Amber LED will flash, Green & Red LEDs will be off, then present the Enrolment card from the new card pack; the reader will beep and all LEDs will be lit. The additional cards will now be valid. Repeat this with each reader and with any additional card packs. Any valid enrolment card can be used to add further packs. This is the same for enrolling function card packs onto a system.

4 - Switch2 - How to reset the controller.

1. Disconnect the power and remove the wires from the Green and Mauve terminals
2. Insert a wire link between the Green and Mauve terminals
3. Reconnect the power (the unit will bleep 4 times)
4. Disconnect the power and remove the link wire, reconnect the Green and Mauve wires
5. Reconnect the power (the unit will bleep 3 times per second). The unit is ready to be enrolled.

Suitability

Security sensitive doors



Accepts customised inserts and bezels



Wet environments



Readers mounted together

12 inches
between
readers

Specifications

Environment	Min	Max	
Operating temperatures - all items	-20 °C (-4 °F)	+55 °C (+131 °F)	
Waterproof			IPX7
Cable length			15 feet
Electrical	Min	Max	
Voltage	10V DC	14V DC	
Current		140 mA	
Carrier frequency			125 kHz
Clock and data bit period			600 µs
Dimensions	Width	Height	Depth
Reader	2 3/4"	4 3/8"	3/8"
Backbox	2 3/8"	4"	1"
Read Range	Token	Keyfob	Hands Free Token
	1 1/2"	1"	15"

Product compliance and limitations

Wiring methods shall be in accordance with the National Electrical Code (ANSI/NFPA70), local codes, and the authorities having jurisdiction.

This device complies with Industry Canada licence-exempt RSS standard(s). Operation is subject to the following two conditions: (1) this device may not cause interference, and (2) this device must accept any interference, including interference that may cause undesired operation of the device.

FCC Compliance

This device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions:

(1) this device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation. Changes or modifications not expressly approved by the party responsible for compliance could void the user's authority to operate the equipment.